


Water Service Re-Pipe


Water meter connection requirements

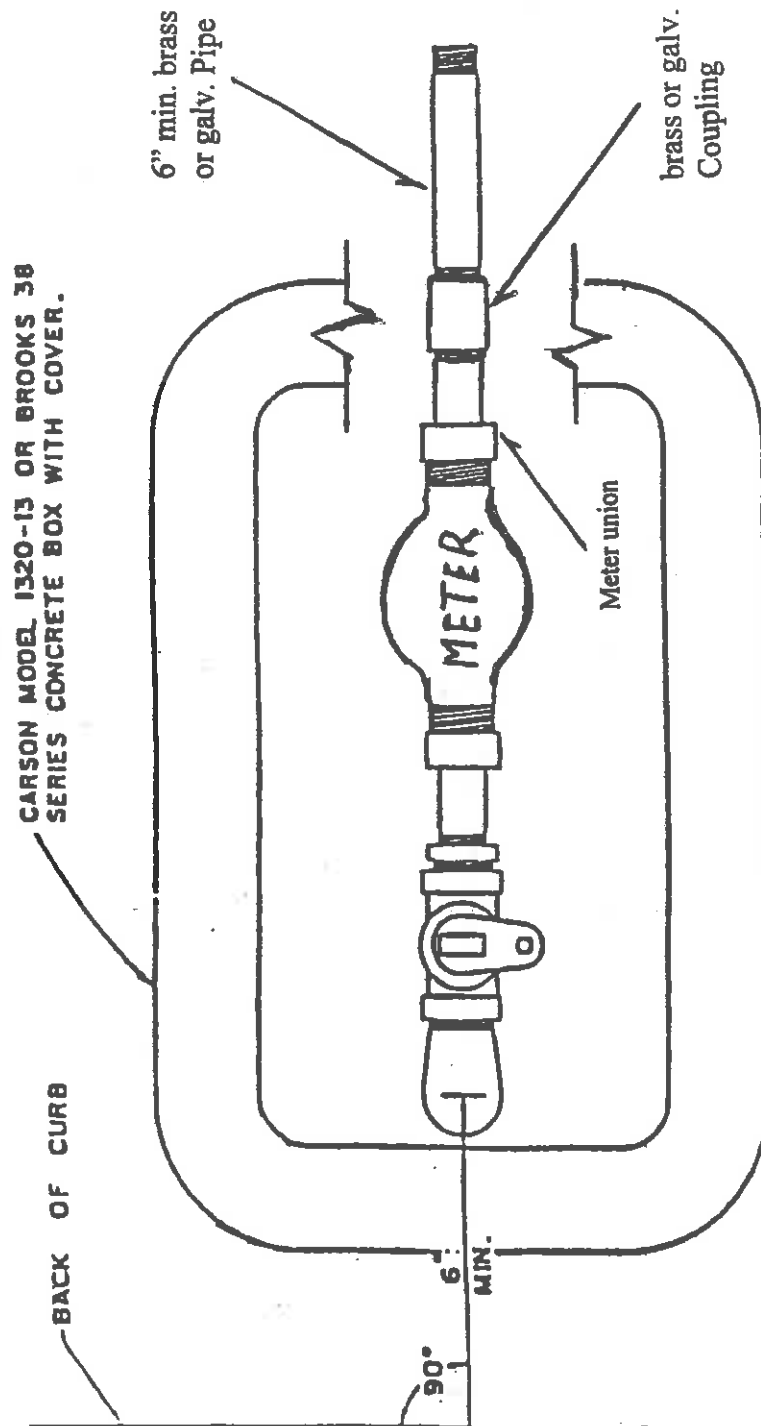

All fittings shown are the property and responsibility of the City of Upland. All connections beyond this point shall be the property owners responsibility.

New Construction

JOHN WEAVER
Insp. for Water Dept
931-4250

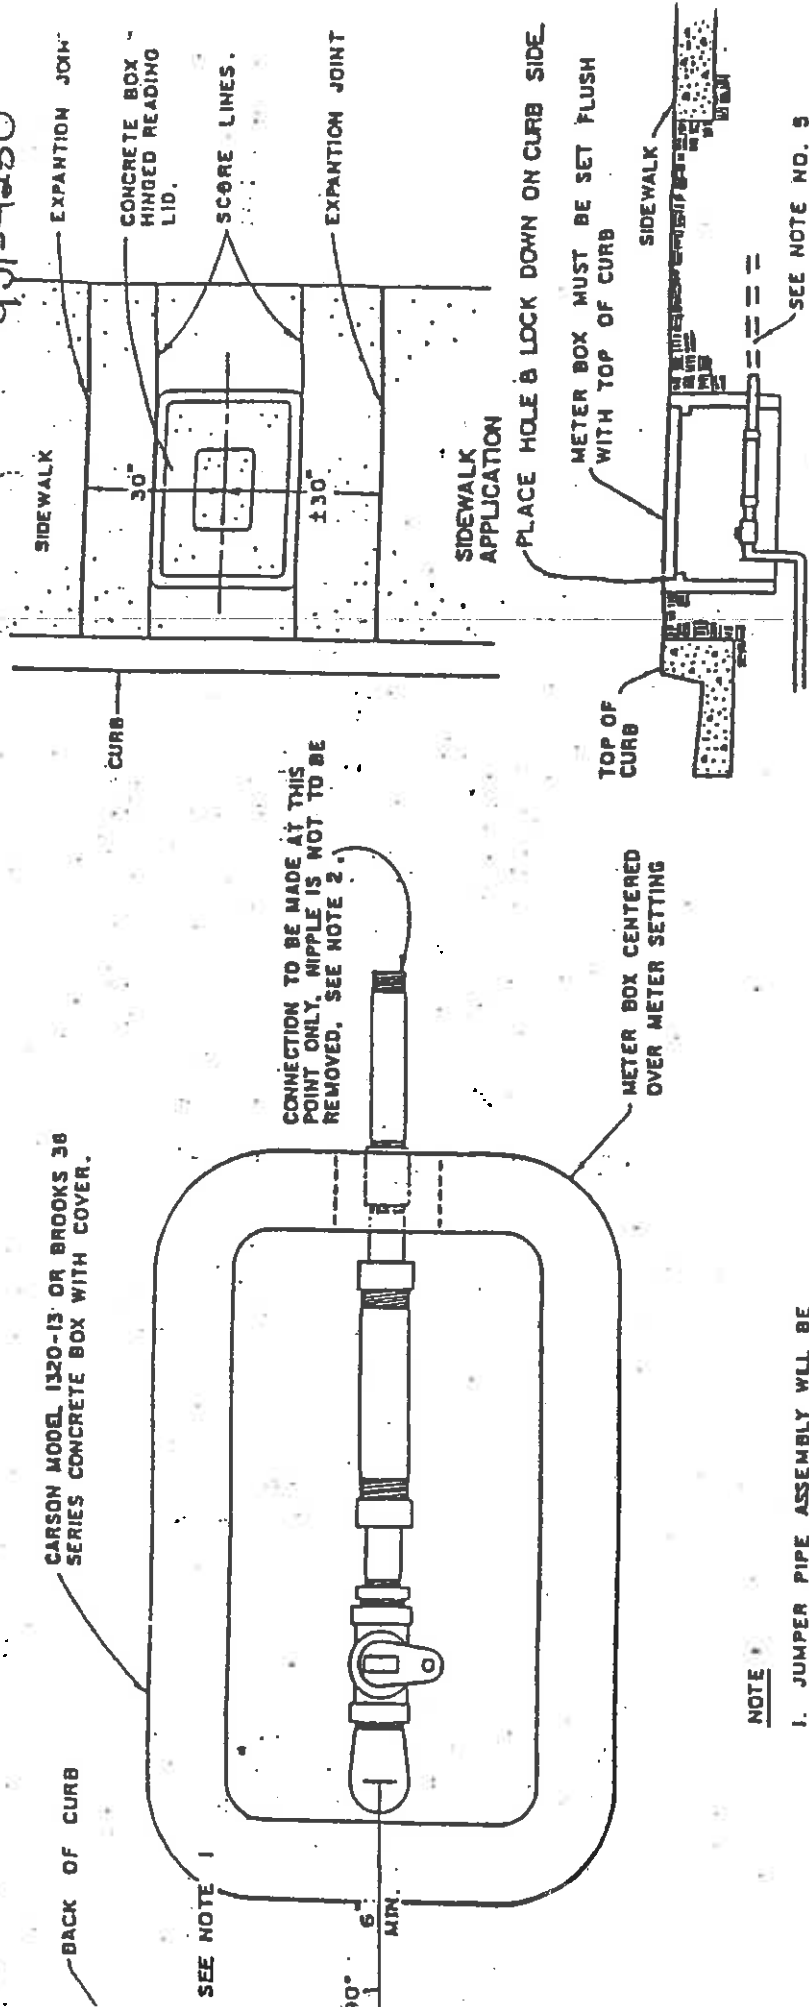

NOTE

1. JUMPER PIPE ASSEMBLY WILL BE SET PERPENDICULAR TO CURB.
2. ALL FITTINGS SHOWN ARE THE PROPERTY AND RESPONSIBILITY OF THE CITY OF UPLAND. ANY CONNECTIONS BEYOND THIS POINT SHALL BE THE PROPERTY OWNERS RESPONSIBILITY.
3. PARKWAY TREES WILL BE PLACED A MINIMUM OF 7 FEET FROM SERVICE.
4. A PERMANENT "W" WILL BE MARKED ON THE FACE OF THE CURB AT EACH WATER SERVICE.
5. WHERE BACKFLOW PREVENTION DEVICES ARE REQUIRED, ALL STEEL PIPE MUST BE INSTALLED TO THE INLET OF THE DEVICE.
6. BOXES & JUMPER PIPE ASSEMBLIES WILL BE FURNISHED BY THE CITY AND INSTALLED BY THE DEVELOPER.

REVISIONS		CITY OF UPLAND STANDARD DRAWING	
NO.	BY	DATE	
1	J.E.C.	10-11-81	
2	S.A.S.	12-15-83	
3	S.A.S.	2-28-84	
			REQUIRED JUMPER PIPE SETTING FOR 5/8" X 3/4" AND 1" METERS
			APPROVED BY <i>John Weaver</i>
			DRAWING NO. W6-6A